



00	01	02	03	04	05	06	07	08	09	10	11	12	13	14
DISTRIBUTION ASSEMBLY														
Block 4														
RATED VOLTAGE (V) $V_n = 400$														
RATED CURRENT (A) $I_n = 64$														
RATED FREQUENCY (Hz) $f_n = 50 - 60$														
BREAKING CAPACITY (kA) $I_{cu} = \quad I_{cw} (1s) =$														
PROTECTION DEGREE: IP54														
RATED DIVERSITY FACTORS:														
REFERENCE STANDARD: CEI EN 61439-3														

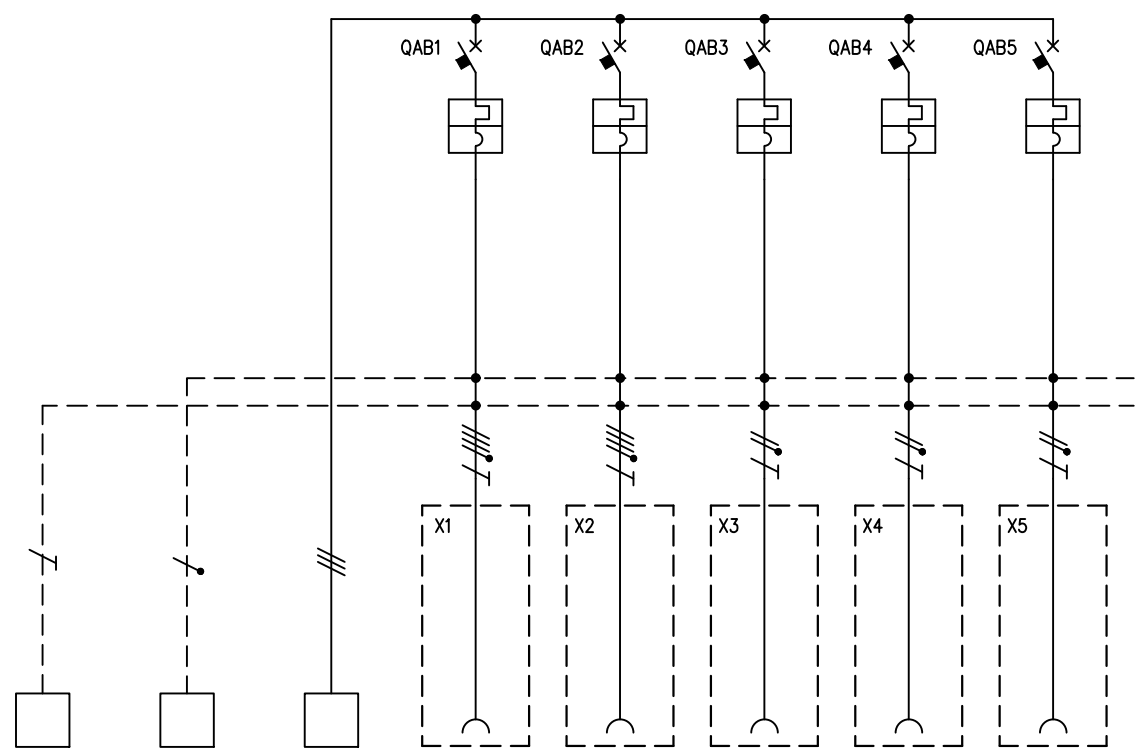


CIRCUIT		1	2	3	4	5	6	7	8					
COMPONENTS DESCRIPTION		Terra	Neutro	Alimentazione Quadro										
PROTECTION DEVICES	TYPE				MT	MT	MT	MT	MT					
	Un (V)				400	400	230	230	230					
	In (A)				32	16	16	16	16					
	N°POLES				3	3	1	1	1					
	CHARACTERISTICS				Curva "C"	Curva "C"	Curva "C"	Curva "C"	Curva "C"					
	BREAKING CAPACITY (kA)													
	Idn (mA)													
PLUGS AND SOCKETS	TYPE				IEC 309	IEC 309	Domo	Domo	Domo					
	Un (V)				346-415	346-415	200-250	200-250	200-250					
	In (A)				32	16	16	16	16					
	N°POLES				3P+N+T	3P+N+T	2P+T	2P+T	2P+T					
	CONFIGURATIONS				6h	6h								
	SCAME PART NUMBER				413.3267	413.1667	570.2561	570.2561	570.2561					
TERMINALS	N°SECTION (sqmm)	16	16	3x16										
CONNECTIONS	L1, L2, L3, N, PE	PE	N	L1,L2,L3	L1,L2,L3,N,PE	L1,L2,L3,N,PE	L1,N,PE	L2,N,PE	L3,N,PE					
	SECTION (sqmm)	10	10	10	4	2,5	2,5	2,5	2,5					
OTHER COMPONENTS							Schuko	Schuko	Schuko					

Distribution assembly Block 4 IP54 series

*Supplied with N°1 cable gland PG21

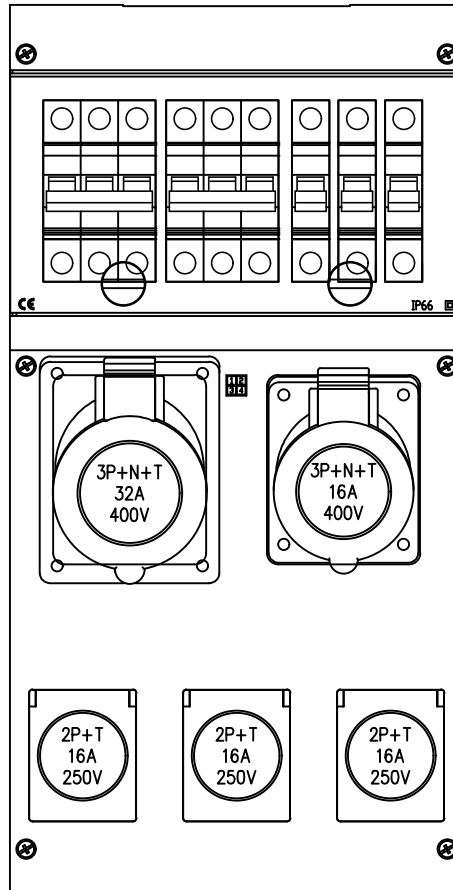

				DATE	25/07/2025	 <p>For legal terms we reserve the property of this drawing with interdiction of reproduction and disclosing to third parties or to competitors</p>			
				DRAWN	S.Facchi				
				CHECK	F.Verzeroli				
REV.	VERSION	DATE	SIGNATURE	APPR.	F.Verzeroli	SCAME PARRE S.p.A.	AF 3020381_130	AF 3020381	PAGE 2 OF 2 NEXT